

Installation, Operation and Maintenance Manual

Reverse Osmosis System

Series PWRO440

PURE WATER

Important

Please read the entire manual before proceeding with the installation and startup:

- Do not use where the water is microbiologically unsafe.
- Always turn off the unit, shut off the feed water, and disconnect the electrical power when working on the unit.
- Never allow the pump to run dry.
- Never start the pump with the reject valve closed.
- Never allow the unit to freeze or operate with a feed water temperature above 100°F (38°C).

Notes

Changes in operating variables are beyond the control of Watts. The end user is responsible for the safe operation of this equipment. The suitability of the product water for any specific application is the responsibility of the end user.

Successful long-term performance of an RO system depends on proper operation and maintenance of the system. This includes the initial system startup and operational startups and shutdowns. Prevention of fouling or scaling of the membranes is not only a matter of system design, but also a matter of proper operation. Record keeping and data normalization are required in order to know the actual system performance and to enable corrective measures when necessary. Complete and accurate records are also required in case of a system performance warranty claim.

Changes in the operating parameters of an RO system can be caused by changes in the feed water or can be a sign of trouble. Maintaining an operation and maintenance log is crucial in diagnosing and preventing system problems. For your reference, a typical log sheet is included in this manual.

Note: Do not use with water that is microbiologically unsafe or of unknown quality without adequate disinfection before or after the system.



PWRO4401

Table of Contents

I. Introduction

- A. Specifications
- B. RO Overview
- C. Pre-treatment

II. Controls, Indicators, and Components

III. Operation

- A. Installation
- B. Plumbing Connections
- C. Electrical
- D. Startup
- E. Control Function
- F. Operation and Maintenance Log
- G. Troubleshooting

IV. Replacement Parts List

V. Membrane Replacement

VI. Appendix

- Temperature Correction Factors

I. Introduction

The separation of dissolved solids and water using RO membranes is a pressure driven temperature dependent process. The membrane material is designed to be as permeable to water as possible, while maintaining the ability to reject dissolved solids.

The main system design parameters require the following:

- Internal flows across the membrane surface must be high enough to prevent settling of fine suspended solids on the membrane surface.
- The concentration of each dissolved ionic species must not exceed the limits of solubility anywhere in the system.
- Pre-treatment must be sufficient to eliminate chemicals that would attack the membrane materials.

A. Specifications


	PWRO4401	PWRO4402	PWRO4403
Maximum Productivity (gallons per day)	2200	4400	6600
Quality (average membrane rejection)	98 %		
Recovery (user adjustable)	15 - 75 %	25 - 75%	32 - 75 %
Membrane Size	4" x 40"		
Number Of Membranes	1	2	3
Prefilter (system ships with one 5 micron cartridge)	20"		
Feed Water Connection	3/4" NPTF		
Product Water Connection (tubing OD)	5/8"		
Reject Water Connection (tubing OD)	5/8"		
Feed Water Required (maximum)	10 gpm	12 gpm	14 gpm
Feed Water Pressure (minimum)	10psi		
Drain Required (maximum)	10 gpm	12 gpm	14 gpm
Electrical Requirement	230V 10 amps	230V 12 amps	230V 15 amps
Motor Horse Power	3/4	1	1 1/2
Dimensions W x D x H (approximate inches)	20 x 20 x 50		20 x 26 x 50
Shipping Weight (estimated pounds)	120	150	180

Notes:

- Maximum production based on a feed water of 77°F, SDI < 1, 1000 ppm TDS, and pH 7. Individual membrane productivity may vary (± 15%). May be operated on other feed waters with reduced capacity.
- Percent rejection is based on membrane manufacturer's specifications; overall system percent rejection may be less.

B. RO Overview

Reverse osmosis systems utilize semipermeable membrane elements to separate the feed water into two streams. The pressurized feed water is separated into purified (product) water and concentrate (reject) water. The impurities contained in the feed water are carried to the drain by the reject water. It is critical to maintain adequate reject flow in order to prevent membrane scaling and/or fouling.

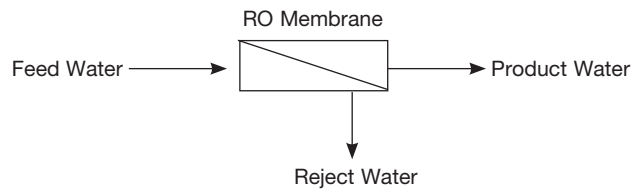

C. Pretreatment

The RO feed water must be pretreated in order to prevent membrane damage and/or fouling. Proper pretreatment is essential for reliable operation of any RO system.

Pretreatment requirements vary depending on the nature of the feed water. Pretreatment equipment is sold separately. The most common forms of pretreatment are described below.

Media Filter - Used to remove large suspended solids (sediment) from the feed water. Backwashing the media removes the trapped particles. Backwash can be initiated by time or differential pressure.

Water Softener - Used to remove calcium and magnesium from the feed water in order to prevent hardness scaling. The potential for hardness scaling is predicted by the Langelier Saturation Index (LSI). The LSI should be zero or negative throughout the unit unless approved antiscalants are used. Softening is the preferred method of controlling hardness scale.

Carbon Filter - Used to remove chlorine and organics from the feed water. Free chlorine will cause rapid irreversible damage to the membranes.

The residual free chlorine present in most municipal water supplies will damage the thin film composite structure of the membranes used in this unit. Carbon filtration or sodium bisulfite injection should be used to completely remove the free chlorine residual.

Chemical Injection - Typically used to feed antiscalant, coagulant, or bisulfite into the feed water or to adjust the feed water pH.

Prefilter Cartridge - Used to remove smaller suspended solids and trap any particles that may be generated by the other pretreatment. The cartridge(s) should be replaced when the pressure drop across the housing increases 5 - 10 psig over the clean cartridge pressure drop. The effect of suspended solids is measured by the silt density index (SDI) test. An SDI of five (5) or less is specified by most membrane manufacturers and three (3) or less is recommended.

Iron & Manganese - These foulants should be removed to less than 0.1 ppm. Special media filters and/or chemical treatment is commonly used.

pH - The pH is often lowered to reduce the scaling potential. If the feed water has zero hardness, the pH can be raised to eliminate CO₂.

Silica: Reported on the analysis as SiO₂. Silica forms a coating on membrane surfaces when the concentration exceeds its solubility. Additionally, the solubility is highly pH and temperature dependent. Silica fouling can be prevented with chemical injection and/or reduction in recovery.

II. Controls, Indicators, and Components (See Figure 1)

- (A) On / Off Switch – Turns the unit on and off.
- (B) Low-pressure indicator – Turns on when low pump inlet pressure is detected.
- (C) Tank full / Interlock indicator – Turns on when the unit is shut down due to high tank or pretreatment interlock.
- (D) Reject Control Valve – Controls the amount of reject flow.
- (E) Reject Recycle Control Valve – Controls the amount of recycle flow.
- (F) Prefilter Outlet Pressure Gauge – Indicate the outlet pressures of the prefilter.
- (G) Pump Discharge Pressure Gauge – Indicates the membrane feed pressure.
- (H) Reject Flow Meter – Indicates the reject flow rate in gallons per minute (gpm).
- (I) Product Flow Meter – Indicates the product flow rate in gallons per minute (gpm).
- (J) Prefilter Housing – Contains the RO prefilter.
- (K) RO Feed Pump – Pressurizes the RO feed water.
- (L) RO Membrane Housing(s) – Contains the RO membrane(s).
- (M) Water Quality Meter – Indicates the quality of the feed and product water in parts per million of total dissolved solids (PPM – TDS).
- (N) Feed Water Inlet.

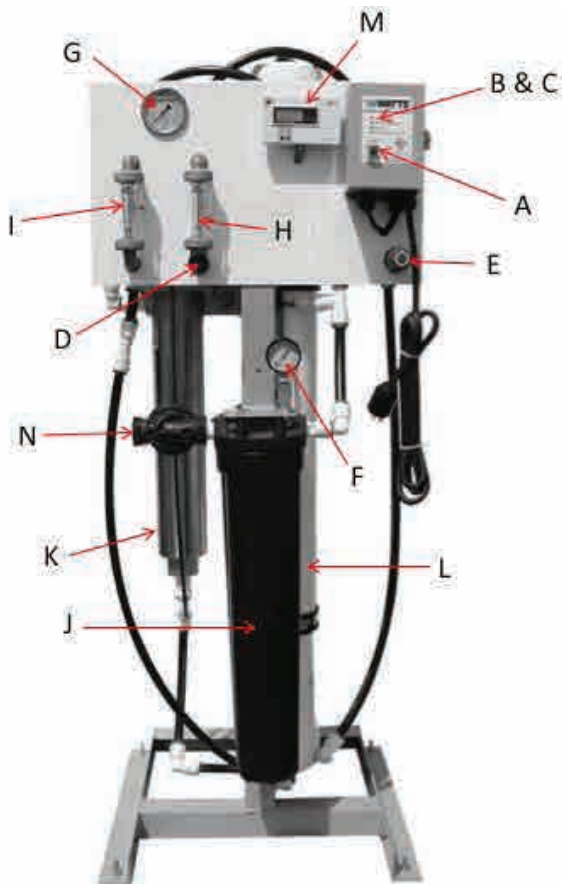


Figure 1

III. Operation

A. Installation

1. Proper pretreatment must be determined and installed prior to the RO system.
2. The water supply and pretreatment equipment should be sufficient to provide a minimum of 10-psi at the maximum feed flow.
3. An electrical disconnect switch located within 10 feet of the unit is recommended.
4. Responsibility for meeting local electrical and plumbing codes lies with the owner / operator.
5. Install indoors in an area protected from freezing and direct sunlight. Space allowances for the removal of the membranes from the pressure vessels should be provided.
6. Verify that a prefilter cartridge is installed in the housing. (see Figure #1, Item J).

B. Plumbing Connections

Note: It is the responsibility of the end user to ensure that the installation is done according to local codes and regulations.

1. Connect the pretreated feed water line to the prefilter inlet (Figure # 1 Item N). A feed water shutoff valve should be located within 10 feet of the system.
2. Temporarily connect the product water outlet to a drain. The product outlet is located behind the panel at the top of the product flow meter. The product water line should never be restricted. Membrane and/or system damage may occur if the product line is blocked.
3. Connect the reject water outlet to a drain. The reject outlet is located behind the panel at the top of the reject flow meter. The reject drain line should never be restricted. Membrane and/or system damage may occur if the reject drain line is blocked. An air gap must be located between the end of the drain line and the drain. The use of a standpipe or other open drain satisfies most state and local codes and allows for visual inspection and sampling.

C. Electrical

Note: It is the responsibility of the end user to ensure that the installation is done according to local codes and regulations.

1. Make sure the on / off switch is in the off position (Figure #1 item A).
2. Wire the common side of the motor starter to the incoming power.
3. Connect the incoming power supply to the contactor terminals as shown.
4. For Tank Level Switch you will need to cut off the plug and wire the float switch to the tank level input on the controller when using this float switch with a Watts commercial RO system. Note: You will need to remove the factory installed jumper wire from the tank level terminals connectors 5 & 6 in the controller. See RO system manual for more details.

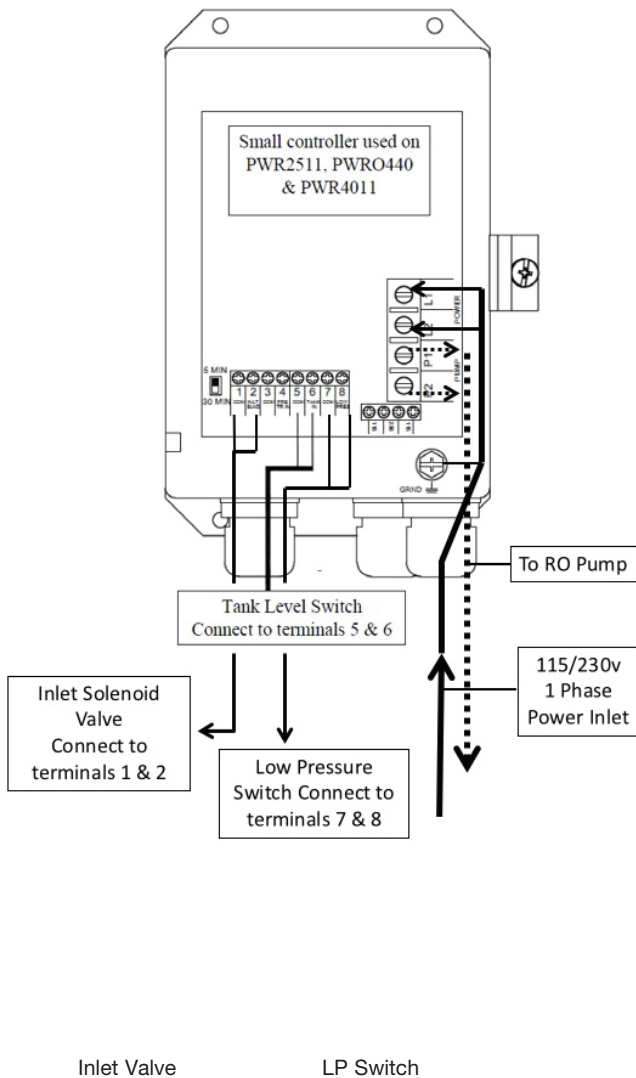


Figure 2

D. Startup

1. Verify that the pretreatment equipment is installed and working properly. Verify that no free chlorine is present in the feed water.
2. Verify that the on / off switch is in the off position.
3. Verify that a filter cartridge is installed in the prefilter housing.
4. Open the reject control valve completely (Figure # 1 item D) by turning it counterclockwise.
5. Close the reject recycle control valve (Figure # 1 item E) completely by turning it clockwise.
6. Open the feed water shutoff valve installed in step III-B-1 above.
7. Move the controller on/off switch to the on position.
8. Allow the unit to run for 15 – 30 minutes to flush the preservative from the membrane(s).
9. Adjust the reject control valves (Figure # 1 items D & E) until the desired flows are achieved. Closing the reject valve increases the product flow and decreases the reject flow. Opening the reject recycle valve decreases both the reject and product flow. See the flow rate guidelines and temperature correction table in the appendix to determine the flow rates for different operating temperatures.
10. Allow the product water to flow to drain for 30 minutes.
11. Turn off the system and connect the product water line to the point of use. The product water line should never be restricted. Membrane and/or system damage may occur if the product water line is blocked.
12. Restart the system and record the initial operating data using the log sheet.

E. Control Function

1. When the power switch is turned on, the pump will run as long as the circuit between the tank level terminals and the interlock terminals are closed. The RO pump and inlet valve will turn on when the level switch contacts are closed (tank not full). The RO pump and inlet valve will turn off if the level switch contacts open (tank full) or the pretreatment interlock contacts open.
2. If the pump suction pressure drops below the pressure switch set point (3 – 5psi) for five (5) seconds, the RO pump and inlet valve will turn off. A red light on the front of the controller will turn on to indicate that the unit has shutdown due to low pressure. Turn the controller off and back on to reset the unit. The controller will automatically reset after 30 minutes. The reset time can be adjusted by moving the jumper cap inside the controller.
3. **Quality Meter** – The quality meter measures the feed water and product water total dissolved solids (TDS) in parts per million (PPM). The lower the TDS the more pure the water is. To check the TDS press the power button, then press either the IN or OUT button. The IN button checks the feed water TDS and the OUT button checks the product water TDS. The meter will automatically turn itself off after a few seconds. The quality meter is powered by two AAA batteries. To replace the batteries, lift the meter out of the bracket and remove the back cover.

F. Operation and Maintenance Log

DATE	PRODUCT GPM	REJECT GPM	PUMP DISCHARGE PRESSURE	FEED TDS PPM	PRODUCT TDS PPM	FEED WATER TEMP	FEED WATER HARDNESS	FEED WATER CHLORINE LEVEL	PRE FILTER INLET PRESSURE	PRE FILTER OUTLET PRESSURE	REMARKS

Note: Change the prefilter when the differential pressure increases by 5 - 10psi over the clean differential pressure.
 Clean the RO membrane(s) when the product flow drops by 15% or more. (See appendix)

G. Troubleshooting

RO Membrane Troubleshooting Guide

SYMPTOMS			LOCATION	POSSIBLE CAUSES	VERIFICATION	CORRECTIVE ACTION
SALT PASSAGE	PERMEATE FLOW	PRESSURE DROP				
Normal to increased	Decreased	Normal to increased	Predominantly first stage	Metal oxide	Analysis of metal ions in cleaning solution.	Improved pretreatment to remove metals. Cleaning with acid cleaners.
Normal to increased	Decreased	Normal to increased	Predominantly first stage	Colloidal fouling	SDI measurement of feed/ X-ray diffraction analysis of cleaning sol. residue.	Optimize pretreatment system for colloid removal. Clean with high pH, anionic detergent formulation.
Increased	Decreased	Increased	Predominantly last stage	Scaling (CaSO ₄ , CaSO ₃ , BaSO ₄ , SiO ₂)	Analysis of metal ions in cleaning sol. Check LSI of reject. Calculate maximum solubility for CaSO ₄ , BaSO ₄ , SiO ₂ in reject analysis.	Increase acid addition and scale inhibitor for CaSO ₃ and CaSO ₄ . Reduce recovery. Clean with an acid formulation for CaCO ₃ , CaSO ₄ and BaSO ₄ .
Normal to moderate increase	Decreased	Normal to moderate increase	Can occur in any stage	Biological fouling	Bacteria count in permeate and reject. Slime in pipes and vessels.	Shock dosage of sodium bisulfite. Continuous feed of low conc. bisulfite at reduced pH. Peracetic acid sterilization. Clean with alkaline anionic surfactant. Chlorine dosage upstream with dechlorination. Replace cartridge filters.
Decreased or moderately increased	Decreased	Normal	All stages	Organic fouling	Destructive testing, e.g. IR reflection analysis.	Optimization of pretreatment system (e.g. coagulation process.) Resin/ activated carbon treatment. Clean with high pH detergent.
Increased	Increased	Decreased	Most severe in the first stage	Chlorine oxidant attack	Chlorine analysis of feed. Destructive element test.	Check chlorine feed equipment and dechlorination equipment.
Increased	Increased	Decreased	Most severe in the first stage	Abrasion of membrane by crystalline material	Microscopic solids analysis of feed. Destructive element test.	Improved pretreatment. Check all filters for media leakage.
Increased	Normal to increased	Decreased	At random	O-ring leaks, End or side seal glue leaks.	Probe test. Vacuum test. Colloidal material passage.	Replace O-rings. Repair or replace elements.
Increased	Normal to low	Decreased	All stages	Conversion too high.	Check flows and pressures against design guidelines	Reduce conversion rate. Calibrate sensors. Increase analysis and data collection.

RO System Troubleshooting

PROBLEM	CORRECTIVE ACTION
General	
High Product Water TDS	
Membrane frozen, high temp, or backpressure.	Replace membrane.
Membrane attack by chlorine	Carbon pre-filter may be exhausted. Replace filter and membrane.
Product seal on end cap.	Determine if seal or O-ring is bad. Replace as needed.
No Product Water or Not Enough Product Water	
Feed water shut off.	Turn on feed water.
Low feed pressure. Feed pressure must be at least 10psi.	Consider booster pump.
Pre-filter cartridge clogged.	Replace pre-filter cartridge.
Membrane fouled.	Determine and correct cause; replace or clean membrane.
Product check valve stuck.	Clean or replace check valve.
Low pump discharge pressure	Adjust reject valve or replace pump
Low feed water temperature	Increase membrane feed pressure or heat the feed water.

IV. Replacement Parts List

A list of common replacement parts is provided below. Contact your Watts representative for replacement parts assistance.


DESCRIPTION
Prefilter, 5 micron, melt blown
RO membrane, low energy
Prefilter pressure gauge 0 – 100psi
Pump discharge pressure gauge 0 – 300psi
Product flow meter 0.5 – 5 gpm
Reject flow meter with valve 0.5 – 5 gpm
Water quality meter
Pump & motor 0.75 HP for PWR04401
Pump & motor 1.0 HP for PWR04402
Pump & motor 1.5 HP for PWR04403
Controller with on/off switch
Low pressure switch, ¼" MPT
Recycle needle valve PVC
Inlet solenoid valve, 1", 24 volt coil
Pressure vessel with end caps, 316 SS

V. Membrane Replacement

1. Turn off the system and close the feed water shutoff valve.
2. Unplug the unit.
3. Disconnect the tubing from the top of the membrane housing(s).
4. Loosen the clamps and remove the top end cap(s).
5. Remove the old membrane(s) by pulling them up and out of the housings. You may need to grab the old by the membrane with a pair of pliers.
6. Install the new membrane(s) in the housing(s) and replace the end caps. The new membranes should be installed in the same orientation as the old membranes.

Note: It is very important that the brine seal does not flip up or roll when installing the membrane brine seal first. Use plenty of glycerin lubricant and use a gentle twisting/rocking motion as you slide the membrane in. If you are unable to install the membrane brine seal first without rolling the seal then lay the unit over, remove the bottom end cap, and install the membrane brine seal last.

7. Reconnect the tubing to the bottom of the membrane housing(s).
8. Follow the start up procedure in section III-D.

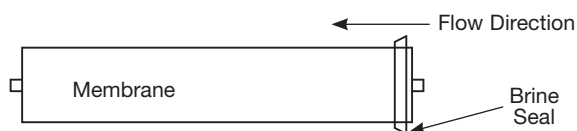

VI. Appendix

The following tables are intended as a guide to determining the flow rates for the PWR0440 Series RO systems. All flows are in gallons per minute (GPM) with 77°F feed water.

Nominal flows for systems operating at 50% recovery with a feed water SDI < 1.

MODEL NUMBER	PWR04401	PWR04402	PWR04403
Product GPM	1.5	3.0	4.5
Reject GPM	1.5	3.0	4.5

Nominal flows for systems operating at 50% recovery with a feed water SDI < 3.

MODEL NUMBER	PWR04401	PWR04402	PWR04403
Product GPM	1.25	2.5	3.75
Reject GPM	1.25	2.5	3.75

Nominal flows for systems operating at 50% recovery with a feed water SDI < 5.

MODEL NUMBER	PWR04401	PWR04402	PWR04403
Product GPM	1	2	3
Reject GPM	1	2	3

Temperature Correction Factors

°C	°F	CORRECTION FACTOR
30	86	1.16
29	84.2	1.13
28	82.4	1.09
27	80.6	1.06
26	78.8	1.03
25	77	1.00
24	75.2	0.97
23	73.4	0.94
22	71.6	0.92
21	69.8	0.89
20	68	0.86
19	66.2	0.84
18	64.4	0.81
17	62.6	0.79
16	60.8	0.77
15	59	0.74
14	57.2	0.72
13	55.4	0.70
12	53.6	0.68
11	51.8	0.66
10	50	0.64
9	48.2	0.62
8	46.4	0.61
7	44.6	0.59
6	42.8	0.57
5	41	0.55

Multiply the nominal product flow at 25°C by the temperature correction factor to determine the flow at various other temperatures.

LIMITED WARRANTY: Certain Watts Pure Water products come with a limited warranty from Watts Regulator Co. Other products may have no warranty or are covered by the original manufacturer's warranty only. For specific product warranty information, please visit www.watts.com or the published literature that comes with your product. Any remedies stated in such warranties are exclusive and are the only remedies for breach of warranty. **EXCEPT FOR THE APPLICABLE PRODUCT WARRANTY, IF ANY, WATTS MAKES NO OTHER WARRANTIES, EXPRESS OR IMPLIED. TO THE FULLEST EXTENT PERMITTED BY APPLICABLE LAW, WATTS HEREBY SPECIFICALLY DISCLAIMS ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, AND IN NO EVENT SHALL WATTS BE LIABLE, IN CONTRACT, TORT, STRICT LIABILITY OR UNDER ANY OTHER LEGAL THEORY, FOR INCIDENTAL, INDIRECT, SPECIAL OR CONSEQUENTIAL DAMAGES, INCLUDING, WITHOUT LIMITATION, LOST PROFITS OR PROPERTY DAMAGE, REGARDLESS OF WHETHER IT WAS INFORMED ABOUT THE POSSIBILITY OF SUCH DAMAGES.**



A Watts Water Technologies Company

USA: Tel. (800) 224-1299 • www.watts.com

Canada: Tel. (888) 208-8927 • www.watts.ca