

# tekmar® - Job Record

## Power Manager 346




**J346**

08/09

Control Name / Location \_\_\_\_\_ Connected to Module \_\_\_\_\_

tN4 Buses	Boil 0 Bus	R	Aux Pump 1	↔ 1	R	Aux Pump 2	↔ 2	R	Aux Pump 3	↔ 3	R	Demands	Bus 3	Bus 2	Bus 1	Boiler Bus 0
Connects To												Connects To				
Location												Location				
												Temp.				
												Schedule				
+												VA	+	+	+	

VA from left side module

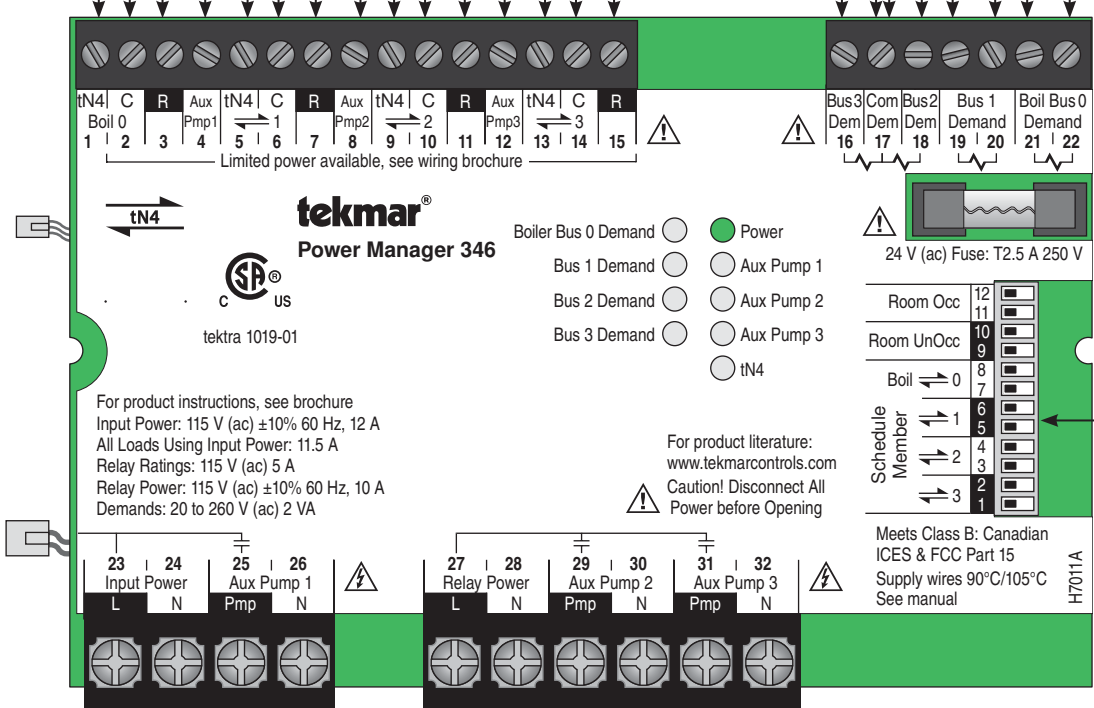


= \_\_\_\_\_

Total demand + Left Side Module VA

Max. 24 VA 24 V (ac)

**Switch Settings**  
(circle / fill-in the correct setting)

Room Occ	12	On	Off
Room UnOcc	11	On	Off
Boil	10	On	Off
Schedule Member	9	On	Off
tN4 Bus 0	8	On	Off
tN4 Bus 1	7	On	Off
tN4 Bus 2	6	On	Off
tN4 Bus 3	5	On	Off
	4	On	Off
	3	On	Off
	2	On	Off
	1	On	Off

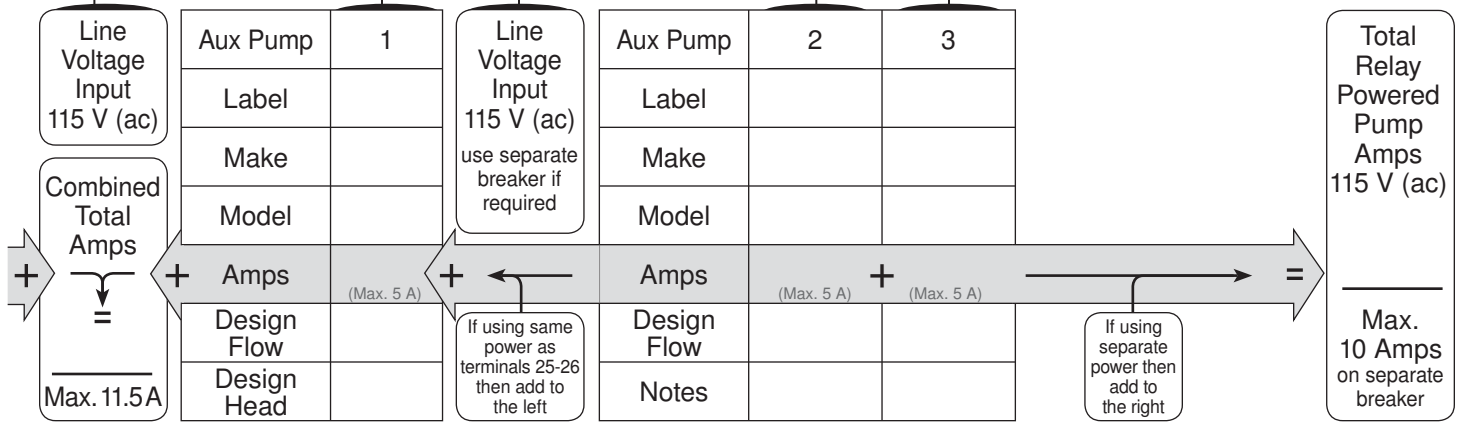

**Notes:**

Blank job records can be downloaded from the tekmar website at <http://www.tekmarcontrols.com>



tekmar Control Systems Ltd., Canada  
tekmar Control Systems, Inc., U.S.A.  
**Head Office: 5100 Silver Star Road**  
**Vernon, B.C. Canada V1B 3K4**  
**(250) 545-7749 Fax. (250) 545-0650**  
**Web Site: [www.tekmarcontrols.com](http://www.tekmarcontrols.com)**

