

tekmar® - Job Record

Universal Reset Module 423



J423

08/09

Control Name / Location _____ Connected to Zone Manager _____

Terminals	Boiler 1 Modulation	Boiler 2 Modulation	Boiler Bus Input	Bus 1 Input	Bus 2 Input	Bus 3 Input	DHW Sensor	Boiler Sensor	Outdoor Sensor
Label									
Make									
Model									
Notes									



Boiler 1


Label	
Make	
Model	
Output	

Boiler 2

Label	
Make	
Model	
Output	

Dip Switch Settings
(circle / fill-in the correct setting)

Unlock	<input type="checkbox"/>	Lock	<input type="checkbox"/>
Boiler Sens Sup	<input type="checkbox"/>	Ret	<input type="checkbox"/>
Off	<input type="checkbox"/>	DHW Sensor	<input type="checkbox"/>
Off	<input type="checkbox"/>	tekmar Stager	<input type="checkbox"/>
Boilers On-Off	<input type="checkbox"/>	Mod	<input type="checkbox"/>
Off	<input type="checkbox"/>	Rotation	<input type="checkbox"/>

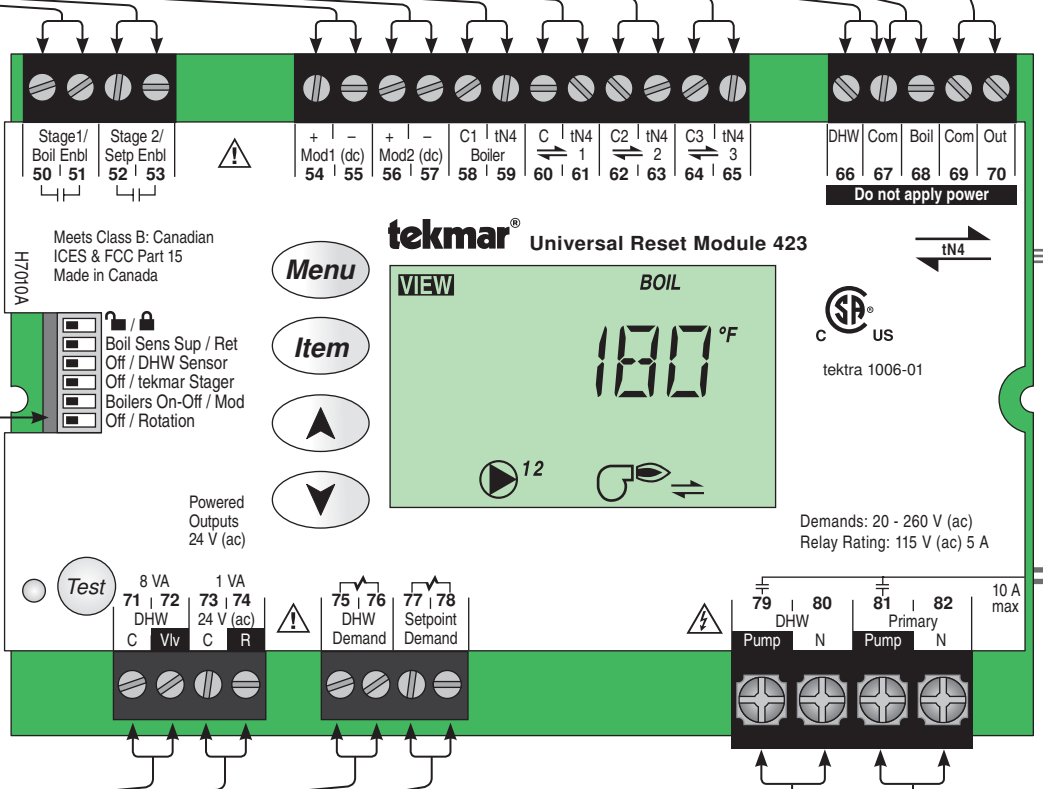

Terminals	DHW Valve	24 V (ac) Auxiliary	DHW Demand	Setpoint Demand
Label				
Make				
Model				
Notes				
VA	+	+	+	+

Terminals	DHW Pump	Primary Pump
Label		
Make		
Model		
Amps	(Max. 5 A)	(Max. 5 A)
Design Flow		
Design Head		

Add Total Amps to Zone Manager Total

Total Amps =

Max. 10 Amps

Menu Settings:

Item	Setting
BUS 1	
BUS 2	
BUS 3	
OUTDOOR DESIGN	
MIX 1 TERMINAL	
MIX 1 INDOOR	
MIX 1 DESIGN	
MIX 1 MINIMUM	
MIX 1 MAXIMUM	
MIX 1 MOTOR	
MIX 2 TERMINAL	
MIX 2 INDOOR	
MIX 2 DESIGN	
MIX 2 MINIMUM	
MIX 2 MAXIMUM	
MIX 2 MOTOR	
MIX 3 TERMINAL	
MIX 3 INDOOR	
MIX 3 DESIGN	
MIX 3 MINIMUM	
MIX 3 MAXIMUM	
MIX 3 MOTOR	
BOILER 1	
BOILER 2	

Item	Setting
BOILER TERMINAL	
BOILER INDOOR	
BOILER DESIGN	
BOILER MINIMUM	
BOILER MAXIMUM	
BOILER DIFFERENTIAL	
STAGE DELAY	
BOILER FIRE DELAY	
BOILER MOTOR	
BOILER MINIMUM MODULATION	
CYCLE LENGTH	
SCHEDULE	
DHW MODE	
DHW OCCUPIED	
DHW UNOCCUPIED	
DHW DIFFERENTIAL	
DHW EXCHANGE OCCUPIED	
DHW EXCHANGE UNOCCUPIED	
SETPOINT MODE	
SETPOINT OCCUPIED	
SETPOINT UNOCCUPIED	
WWSD OCCUPIED	
WWSD UNOCCUPIED	

Blank job records can be downloaded from the tekmar website at <http://www.tekmarcontrols.com>



tekmar Control Systems Ltd., Canada
 tekmar Control Systems, Inc., U.S.A.
Head Office: 5100 Silver Star Road
Vernon, B.C. Canada V1B 3K4
(250) 545-7749 Fax. (250) 545-0650
Web Site: www.tekmarcontrols.com

