

tekmar® - Job Record

Mixing Expansion Module 444



J444

08/09

Control Name / Location _____ Connected to _____

DIP Switch Settings
(circle/ fill-in the actual setting)



0-10 V (dc) 2-10 V (dc)
Actuator Variable

Terminals	System Pump	Floating Action Motor	Modulating Device
Label			
Make			
Model			
Notes			
VA	N/A		N/A

+3 VA +

Is jumper cut?

Yes No

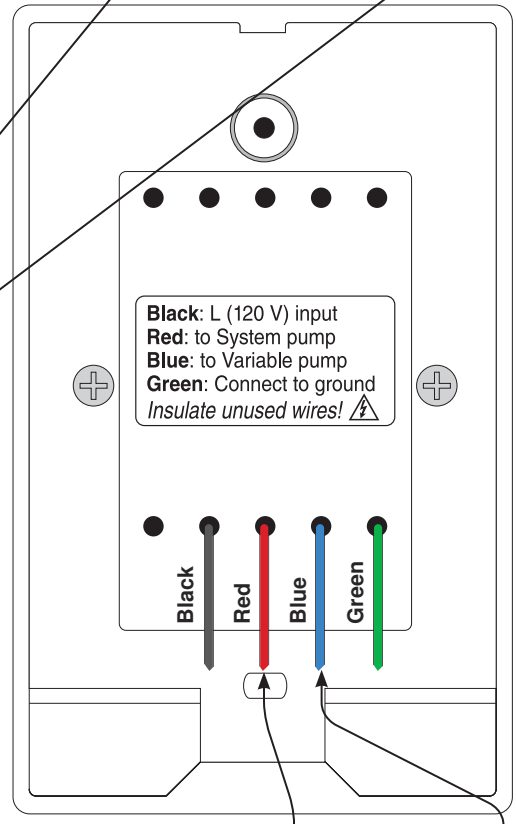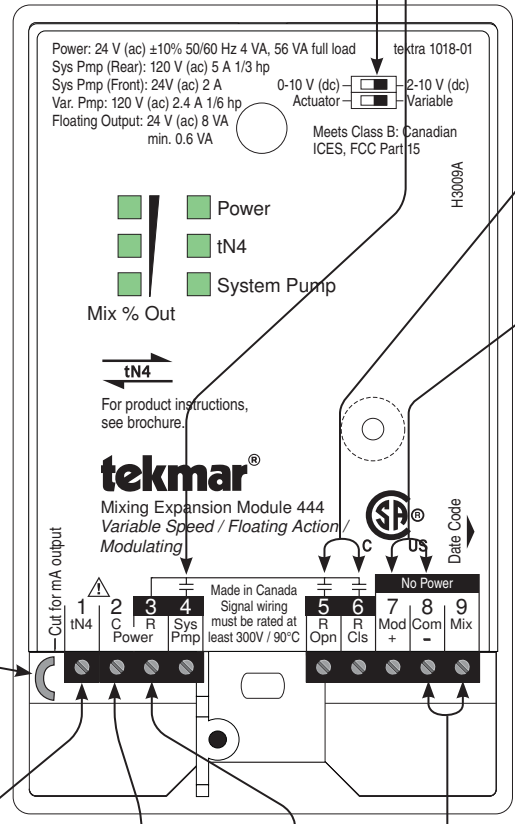

Terminals	tN4	C	R	Mix Sensor
Bus #		N/A	N/A	N/A
Source				
Location				

Name	Mix System Pump	Injection Pump
Label		
Make		
Model		
Amps	(Max. 5 A)	(Max. 2.4 A)
Design Flow		
Design Head		

Blank job records can be downloaded from the tekmar website at <http://www.tekmarcontrols.com>



tekmar Control Systems Ltd., Canada
tekmar Control Systems, Inc., U.S.A.
Head Office: 5100 Silver Star Road
Vernon, B.C. Canada V1B 3K4
(250) 545-7749 Fax. (250) 545-0650
Web Site: www.tekmarcontrols.com