




Accessories

J482

01/12

Replaces: 10/09

Control Location _____

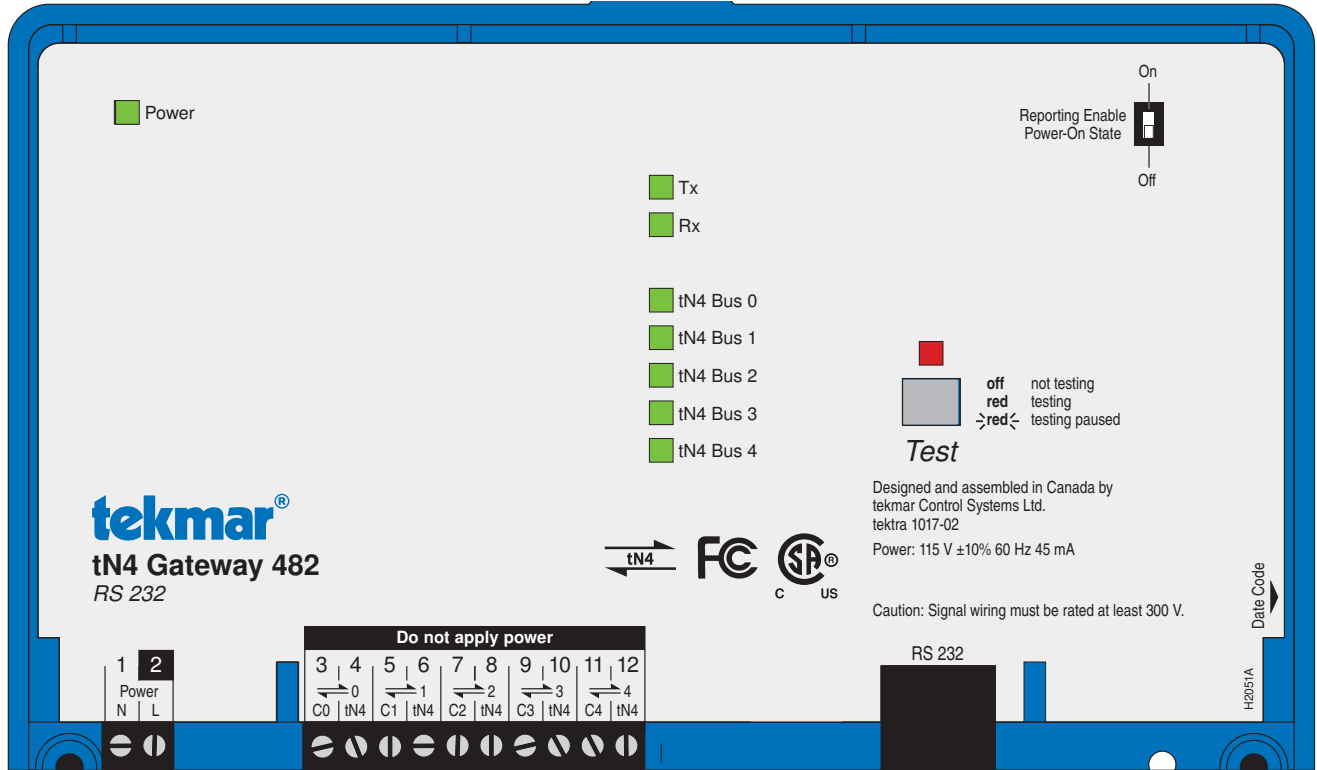

Line Voltage Input
115 V (ac)

tN4 Bus	Connected To
0	
1	
2	
3	
4	

Home Automation System

Thermostats

Bus Address	Thermostat Type	Thermostat Location / Name	Area

